


## 2 COMPARTMENT 2,700 GALLON POLYETHYLENE SEPTIC TANK

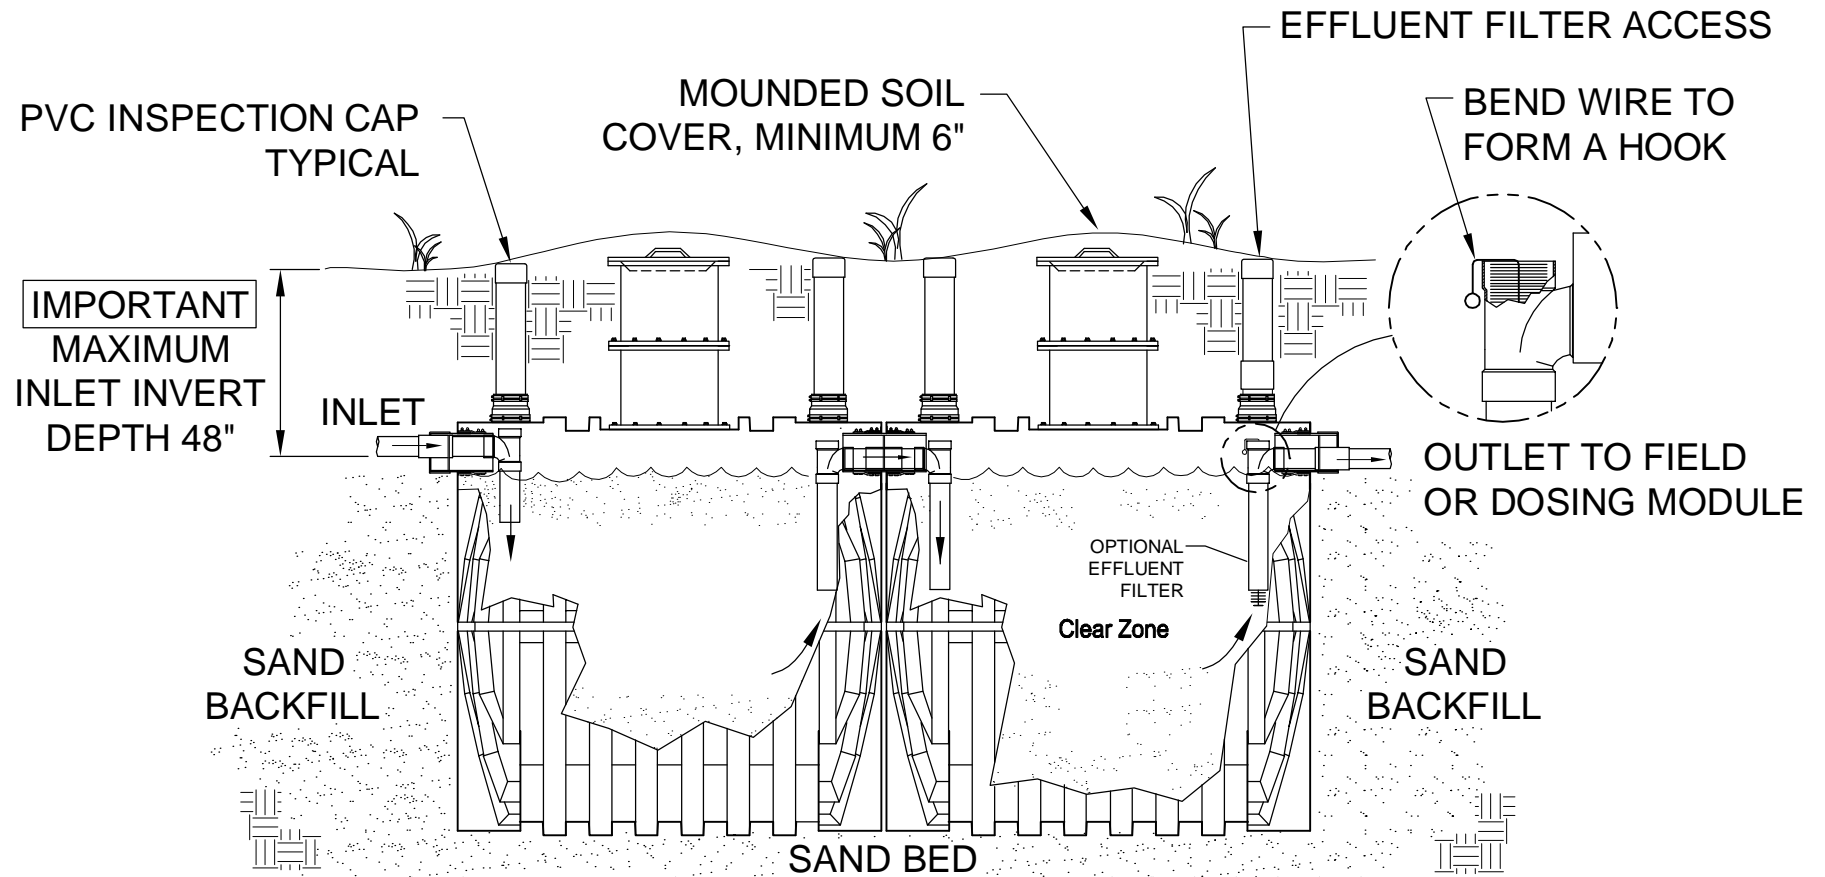

- DOUBLE OCTANK TREATMENT VOLUME = 2700 GALLONS
- 1800 GALLONS (2/3) + 900 GALLONS (1/3)
- TRADITIONAL (2) COMPARTMENT DESIGN

**⚠ WARNING**  
**WASTEWATER SYSTEMS MUST BE APPROVED IN ADVANCE BY THE LOCAL PUBLIC HEALTH DEPARTMENT PRIOR TO INSTALLATION.**

NOT TO SCALE, FOR ILLUSTRATION ONLY

Darco Inc.  
 All Rights Reserved  
 5-19-10